


**ELEVATION**

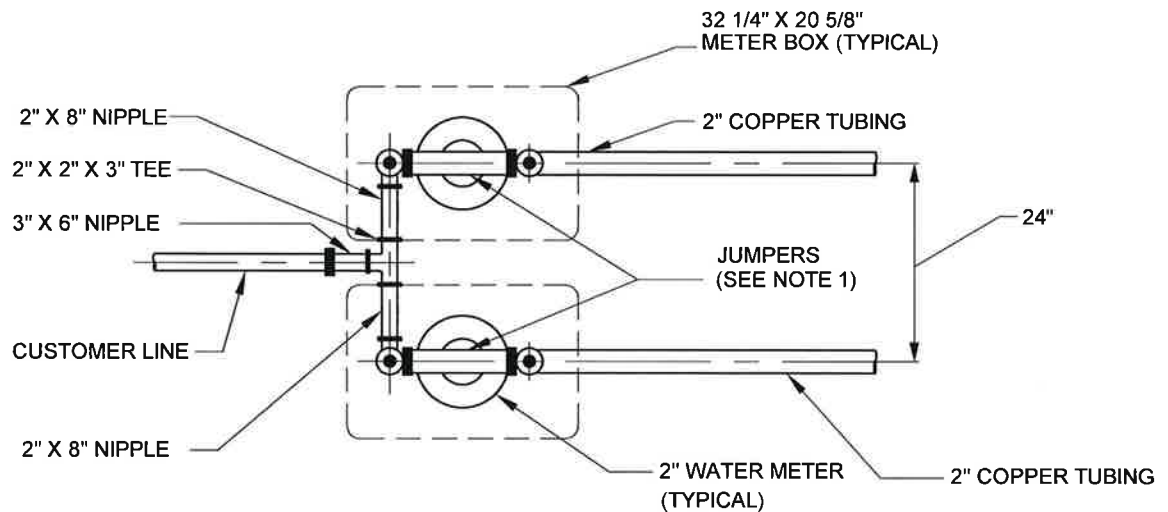

**PLAN**

**SERVICE SYMBOL DESIGNATION:**

① (2) 2"CL

**NOTES:**

1. SERVICE FITTINGS AND STOPS USED WITH COPPER TUBING SHALL BE "COMPRESSION" TYPE.
2. THE CONTRACTOR MAY PLACE TWO(2) JUMPERS FOR SIZING PURPOSES ONLY, NO WATER USAGE PERMITTED.
3. SWAGED-AND-SOLDERED JOINTS ARE PERMITTED ONLY WHEN SERVICE LATERAL IS INSERTED THROUGH A BORED HOLE AND APPROVED BY ENGINEER AND/OR INSPECTOR PRIOR TO INSTALLATION.

**3 INCH SERVICE INSTALLATION**

**WDS - 002**



**LONG BEACH  
WATER DEPARTMENT**

RECOMMEND

*Robert J. [Signature]*

DIVISION ENGINEER

APPROVED

*[Signature]*

DIRECTOR OF ENGINEERING

DATE: 11/11/14

SCALE: N.T.S.

SHEET 1 OF 1